


PLAN
NOT TO SCALE

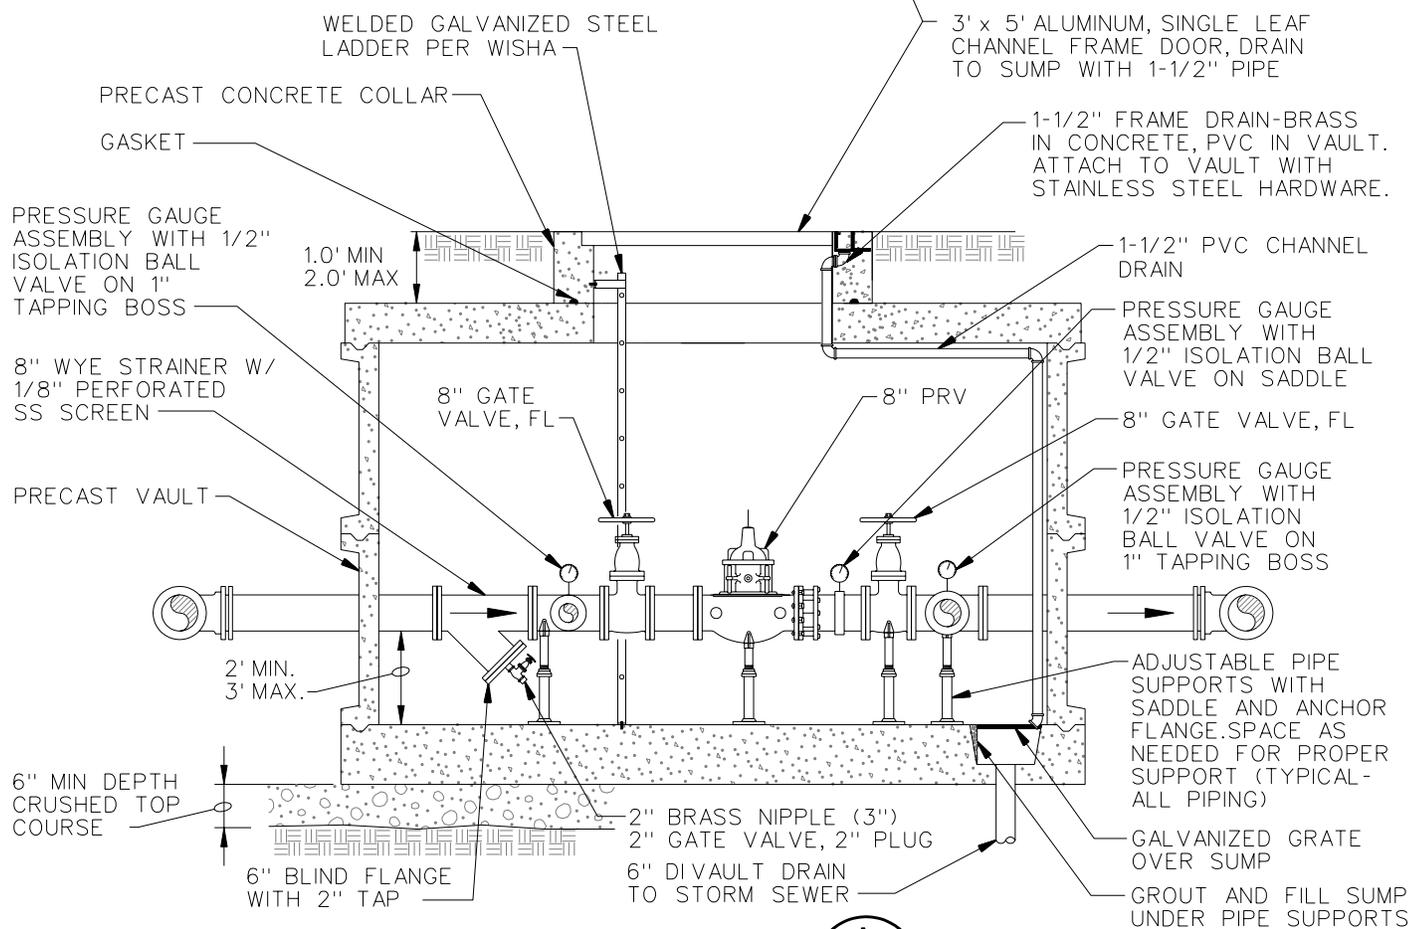

SECTION A
NOT TO SCALE 708

NOTES:

1. 8" PRV STATION SHOWN. 6" PRV STATION IS IDENTICAL EXCEPT THE UPSTREAM AND DOWNSTREAM PIPING, FITTINGS, AND VALVES ARE 6".
2. PAINT ALL EXPOSED PIPING AND FITTINGS WITHIN VAULT AND ABOVE GRADE.
3. ALL VALVES INSIDE VAULT TO HAVE HAND WHEEL OPERATORS.
4. SET COVER SLAB FLUSH WITH SIDEWALK OR CURB ELEVATION IF LOCATED IN LAWN AREA. SET COVER SLAB APPROX. 2" ABOVE FINISHED GRADE IF LOCATED IN LANDSCAPING AREA.

APPROVED: WILLIAM J. CAMPBELL
REV. DATE: JULY 01, 2007



STANDARD DETAILS		
6" AND 8" PRV STATION PLAN AND SECTION		
FILE	SD709A.DGN	DRAWING NO. 709A

WATER/WASTEWATER DIVISION

EXPIRES: 09-08-2008

City of Redmond
WASHINGTON